
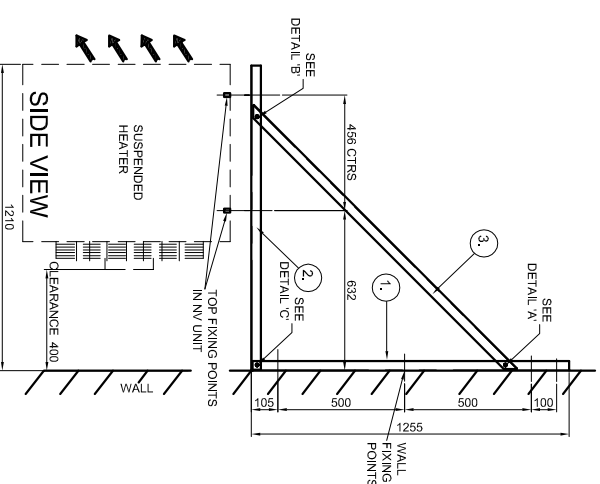
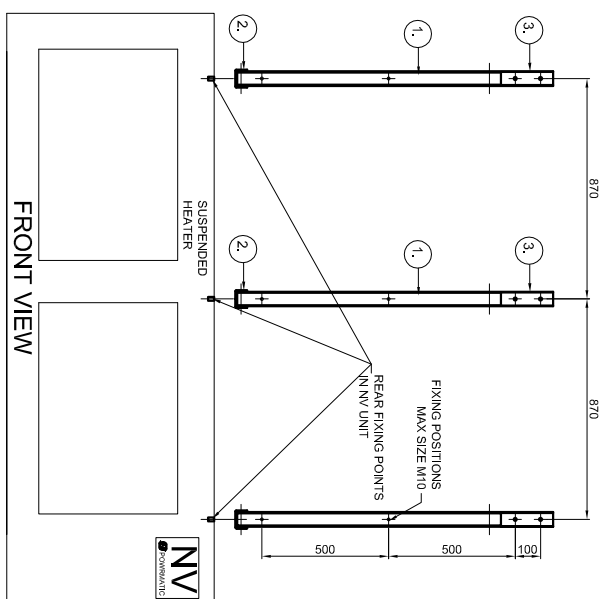
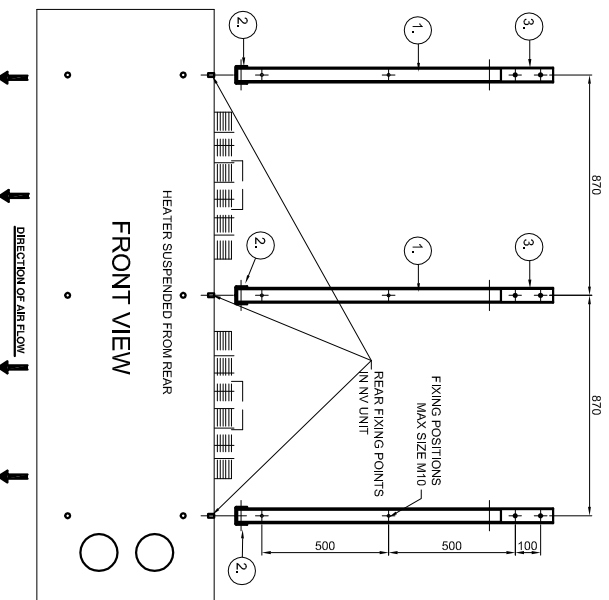


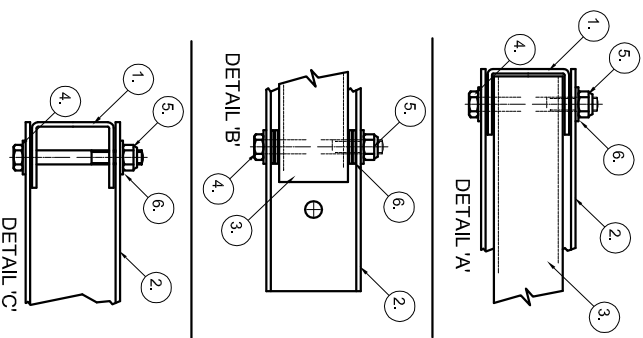

NOTES:-

KIT NUMBER = NV(UNIT SIZE)WB

QUANTITIES SHOWN MAKE 1 ARM.

FOR UNITS 90 > 140 KW 3 x ARMS REQUIRED

TOTAL WEIGHT PER 3 ARM KITS
INCLUDING HARDWARE = **13.5 KG**

VERTICAL DISCHARGE

ASSEMBLY AND INSTALLATION
AS PER STANDARD HORIZONTAL
DISCHARGE CONFIGURATION.

STANDARD HORIZONTAL DISCHARGE CONFIGURATION

ASSEMBLE FRAME AS SHOWN IN DETAILS A-B & C.
THE FRAMES ARE FIXED TO THE WALL. IT IS THE INSTALLERS
RESPONSIBILITY TO USE APPROPRIATE FIXINGS (NOT SUPPLIED).
HEATER IS SUSPENDED FROM THE FRAMES AT THE REQUIRED HEIGHT
USING BOLTS OR DROP RODS (NOT SUPPLIED).
ENSURE THE BOLTS / DROP ARE FITTED WITH LOCKING NUTS.

FOR PARTS LIST SEE
SPREAD SHEET NV 053-02



Powrmatic Ltd
Winterhay Lane,
Ilminster,
Somerset.
Tel: 01460 53535
Fax: 01460 52341
Web: www.powrmatic.co.uk
E mail: r&d@powrmatic.co.uk

This drawing is copyright
and the property of
POWRMATIC LIMITED.
It must not be used
without their knowledge,
nor communicated to any
other person or company.
APPROVED BY:

ITEM PART NUMBER DESCRIPTION QTY

TA19 9PO.

DRAWN	J/A No	DCR No	DATE	MODIFICATIONS	ISSUE
JRW/6621	898026	8.09	18.4.05	MADE 90-140 UNITS ONLY	3.
JRW/4089	-	-	-	-	2.

UNSPEC. TOLS.
Hole centers $\pm 0.25\text{mm}$
General $\pm 0.5\text{mm}$
Finished sizes $\pm 1.0\text{mm}$

TITLE:
WALL SUSPENSION BRACKET
NV UNIT HEATERS 90-120-140



PROJECTION: DRG NO:

NV 053 / 02